




(SPACE ABOVE CEILING MUST BE VENTILATED.)

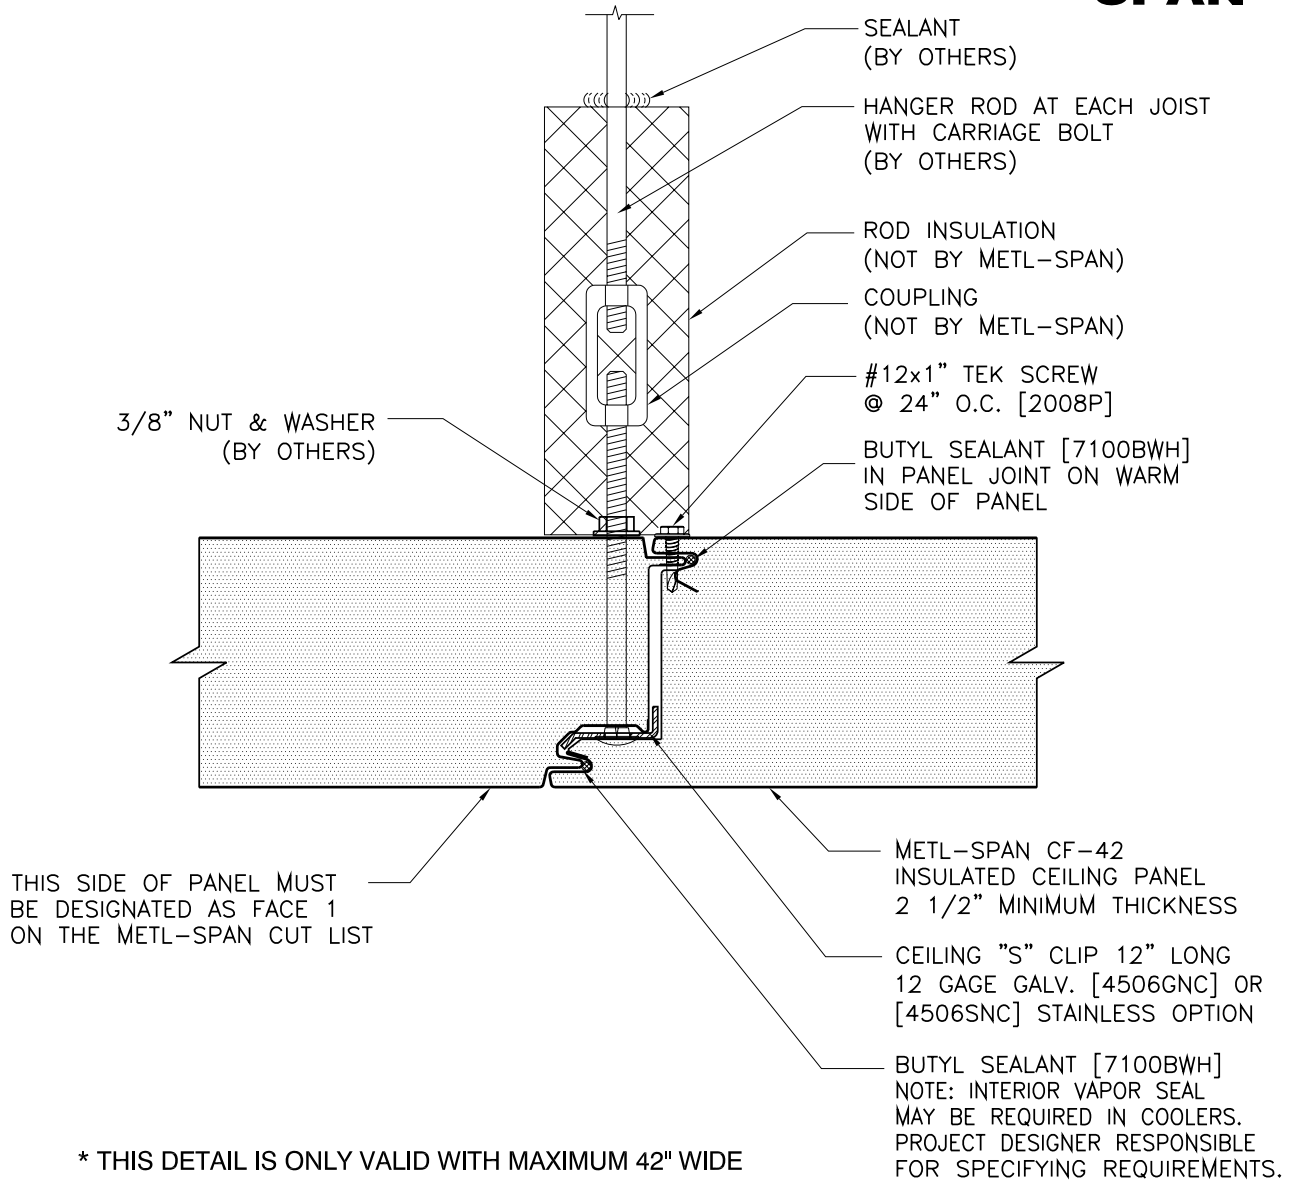

* THIS DETAIL IS ONLY VALID WITH MAXIMUM 42" WIDE PANELS AND A MINIMUM THICKNESS OF 2 $\frac{1}{2}$ ".

NOTE: BRACING OF ROD MAY BE REQUIRED. DESIGNED AND SUPPLIED BY OTHERS.

ALL CEILING SUPPORT COMPONENTS AND PANELS MUST BE INSTALLED COMPLETE PRIOR TO ALLOWING ANY TRAFFIC ON CEILING.

REFER TO SHEET "CS-INFO" FOR ADDITIONAL INFORMATION REGARDING THE APPLICATION OF SEALANTS, FASTENERS AND CLOSURE MATERIALS.

CONSULT METL-SPAN TO DETERMINE ALLOWABLE LOAD AND SPACING OF ATTACHMENT

CEILING SUPPORT DETAIL

DATE: JUNE 15, 2012

APPLICATION:
FREEZER OR COOLER

CS-CG-01
1 OF 2