


(SPACE ABOVE CEILING MUST BE VENTILATED.)

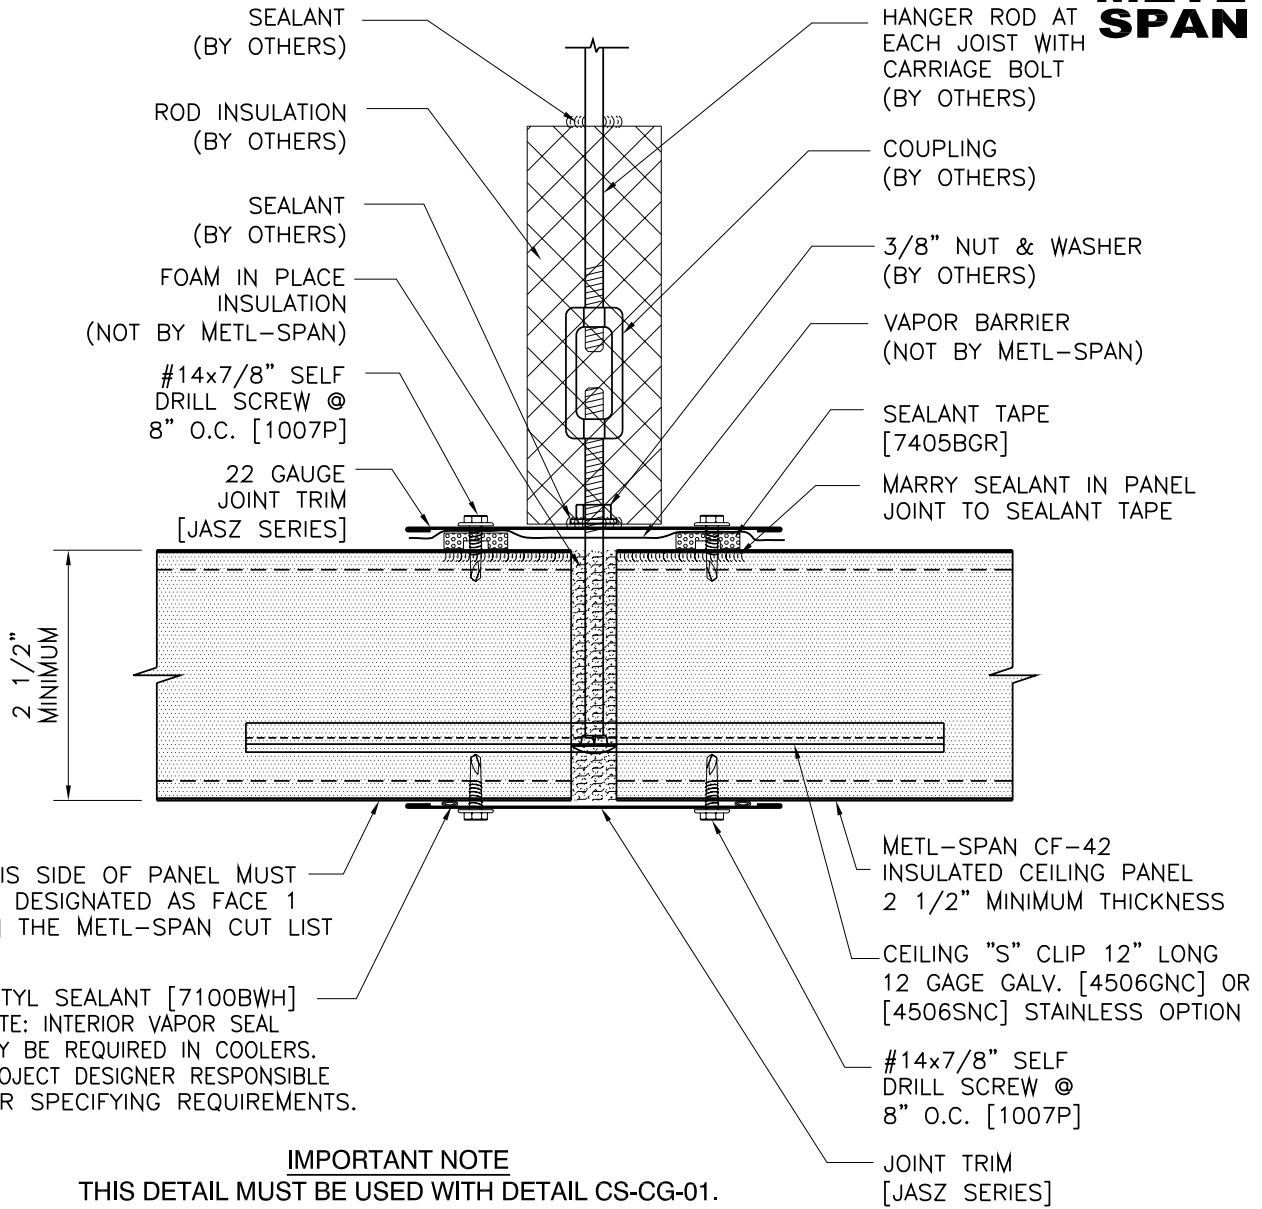

IMPORTANT NOTE

THIS DETAIL MUST BE USED WITH DETAIL CS-CG-01.
INTERMEDIATE ATTACHMENT IS REQUIRED.

NOTE: BRACING OF ROD MAY BE REQUIRED.
DESIGNED AND SUPPLIED BY OTHERS.

* THIS DETAIL IS ONLY VALID WITH MAXIMUM 42" WIDE PANELS
AND A MINIMUM THICKNESS OF 2 1/2".

ALL CEILING SUPPORT COMPONENTS AND PANELS MUST BE INSTALLED
COMPLETE PRIOR TO ALLOWING ANY TRAFFIC ON CEILING.

REFER TO SHEET "CS-INFO" FOR ADDITIONAL INFORMATION REGARDING THE
APPLICATION OF SEALANTS, FASTENERS AND CLOSURE MATERIALS.

CONSULT METL-SPAN TO DETERMINE ALLOWABLE LOAD AND SPACING OF ATTACHMENT

CEILING SUPPORT DETAIL

DATE: JUNE 15, 2012

APPLICATION:
FREEZER OR COOLER

CS-CG-02
2 OF 2