


(SPACE ABOVE CEILING MUST BE VENTILATED.)

WARM SIDE

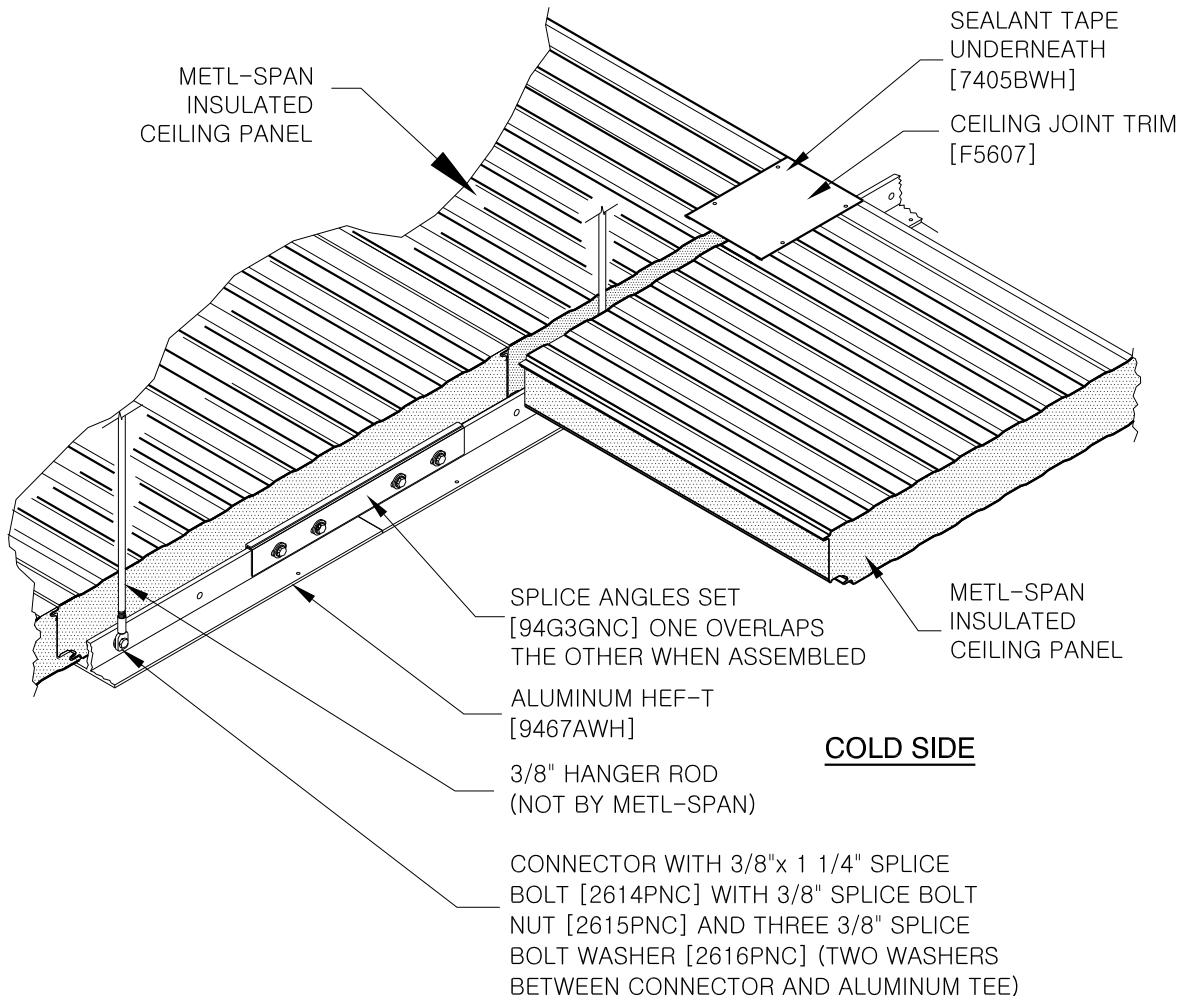

NOTE: DEPENDING ON PANEL AND SUPPORT SYSTEM, 16 GA ANGLE MAY BE REQUIRED TO BE SUPPORTED BY ROOF STEEL, METHOD OF SUPPORT NOT BY BY METL-SPAN. PLEASE REFERENCE CS-CG-04.

NOTE: ALL CEILING SUPPORT COMPONENTS AND PANELS MUST BE INSTALLED COMPLETE PRIOR TO ALLOWING ANY TRAFFIC ON CEILING.

NOTE: REFER TO SHEET "CS-INFO" FOR ADDITIONAL INFORMATION REGARDING THE APPLICATION OF SEALANTS, FASTENERS AND CLOSURE MATERIALS. CONSULT METL-SPAN TO DETERMINE ALLOWABLE LOAD AND SPACING OF ATTACHMENT.