

Metl-Span CF-42 Striated Wall Panels
24 Ga. Exterior / 26 ga. Interior Facings
Allowable Connection Load^{1,5,6,7,8} (psf)
Two or More Equal Spans

Panel Type ²	Design Criteria ^{3,4}	Support Span							
		5 ft	6 ft	7 ft	8 ft	9 ft	10 ft	11 ft	12 ft
2" Thick	Connection FP1	31.6	25.8	21.8	18.8	16.6	14.8	13.3	12.2
	Connection FP2	46.3	37.8	31.9	27.5	24.2	21.6	19.5	17.8
	Connection FP3	58.4	47.7	40.2	34.8	30.6	26.1	22.0	18.7
2½" Thick	Connection FP1	33.5	27.3	23.0	19.9	17.4	15.5	14.0	12.8
	Connection FP2	47.7	38.9	32.8	28.3	24.9	22.2	20.0	18.2
	Connection FP3	60.3	49.2	41.5	35.8	31.4	28.0	25.3	23.0
3" Thick	Connection FP1	35.3	28.8	24.3	20.9	18.4	16.3	14.7	13.4
	Connection FP2	49.0	40.0	33.7	29.1	25.5	22.7	20.5	18.6
	Connection FP3	62.1	50.7	42.7	36.9	32.4	28.8	26.0	23.6
	Connection FP4	71.4	58.3	49.1	42.4	37.2	33.1	29.8	27.2
4" Thick	Connection FP1	43.4	35.6	30.0	25.9	22.7	20.2	18.1	16.5
	Connection FP2	63.6	52.1	44.0	37.9	33.2	29.6	26.6	24.2
	Connection FP3	75.1	61.5	51.8	44.7	39.2	34.9	31.4	28.5
	Connection FP4	80.4	65.8	55.5	47.9	42.0	37.4	33.6	30.5
	Connection FP5	84.1	68.9	58.1	50.1	43.9	39.1	35.2	32.0
	Connection FP9	90.4	74.1	62.5	53.8	47.2	42.0	37.8	34.3
	Connection FP10	94.6	77.5	65.3	56.3	49.4	44.0	39.5	35.9

Notes:

1. The Load Span Table above is based on Allowable Stress Design (ASD). For loads calculated based on ASCE 7-10 (LRFD), please refer to section 2.4.1 of ASCE 7-10 for the applicable load combinations using Allowable Stress Design.
2. Based on CF-42 panel with 24 ga. Striated exterior and 26 ga. Light Mesa interior face (min $F_y = 33$ ksi).
3. Fastener pattern FP1 is based on CF panel clips fastened to min. 14 ga. steel. Fastener options will be (2) ¼"-14 SDS Type 3, (2) ¼"-14 Self-Tapping, (2) ¼"-14 Type 5 SDS, (2) ¼"-20 Type 5 SDS, or (2) ¼"-28 Type 5 SDS. Fastener selection will be based on fastener pullout capacity from support steel members.
4. The fastener patterns FP2, FP3, FP4, and FP5, include FP1 plus 1, 2, 3, and 4 blind rivets, respectively, at supports per panel width. Blind rivet spacing is 10.5" o.c. from female edge of panel seam.
5. The through fasteners (FP9) are as follows: Panels fastened to min. 14 ga. steel supports with (4) ¼"-14 SDS Type 3, (4) ¼"-14 Self-Tapping, (4) ¼"-14 Type 5 SDS, (4) ¼"-20 Type 5 SDS, or (4) ¼"-28 Type 5 SDS with nominal 5/8" diameter neoprene bonded washers spaced at 8.4" o.c. Fastener shall be of sufficient length to penetrate through the support a minimum of ¾". Fastener selection will be based on fastener pullout capacity from support steel members.
6. The through fasteners (FP10) are as follows: Panels fastened to min. 14 ga. steel supports with (5) ¼"-14 SDS Type 3, (5) ¼"-14 Self-Tapping, (5) ¼"-14 Type 5 SDS, (5) ¼"-20 Type 5 SDS, or (5) ¼"-28 Type 5 SDS with nominal 5/8" diameter neoprene bonded washers spaced at 8.4" o.c. Fastener shall be of sufficient length to penetrate through the support a minimum of ¾". Fastener selection will be based on fastener pullout capacity from support steel members.
7. Allowable positive or suction load is the lowest value of panel bending strength, shear strength, deflection limit and connection strength for each fastener pattern.
8. Allowable loads based on panel stress and deflection design criteria are derived from ASTM E72 structural testing and calculated with factor of safety of 2.5 for bending stress, 3.0 for shear stresses and deflection limitation of L/180.
9. The panel connection strength was determined from ASTM E1592 testing and the allowable loads are calculated with factor of safety of 2.
10. The structural capacity of the purlins are not considered and must be examined independently.

Metl-Span Striated Wall Panels
24 Ga. Exterior / 26 ga. Interior Facings
Allowable Connection Load^{1,6,7,8} (psf) for Two or More Equal Spans

Panel Type ²	Fastener ^{3,4,5}	Thickness	Support Span								
			4 ft	5 ft	6 ft	7 ft	8 ft	9 ft	10 ft	11 ft	12 ft
36" wide	FP1	2"	54.5	42.6	34.8	29.3	25.3	22.3	19.9	18.0	16.4
		2.5"	56.5	44.1	36.0	30.3	26.2	23.0	20.5	18.5	16.8
		3"	58.2	45.6	37.2	31.4	27.0	23.7	21.1	19.0	17.3
		4"	61.4	48.3	39.5	33.3	28.7	25.2	22.4	20.2	18.3
	FP2	2"	65.6	51.2	41.8	35.3	30.5	26.8	23.9	21.6	18.7
		2.5"	71.1	55.5	45.3	38.2	33.0	29.0	25.8	23.3	21.2
		3"	76.4	59.8	48.9	41.2	35.5	31.1	27.7	25.0	22.7
		4"	86.8	68.2	55.9	47.1	40.6	35.6	31.7	28.5	25.9
	FP3	2"	87.9	68.6	56.0	45.8	37.6	31.2	26.1	22.0	18.7
		2.5"	89.6	70.0	57.2	48.2	41.6	36.5	32.6	29.1	25.0
		3"	91.1	71.3	58.3	49.1	42.3	37.2	33.1	29.8	27.1
		4"	93.6	73.6	60.3	50.8	43.8	38.4	34.2	30.8	27.9
30" wide	FP1	2"	71.7	55.9	45.7	38.5	33.3	29.3	26.1	22.0	18.7
		2.5"	74.0	57.8	47.2	39.8	34.3	30.2	26.9	24.3	22.1
		3"	76.1	59.6	48.7	41.0	35.3	31.0	27.6	24.9	22.7
		4"	79.9	62.8	51.4	43.4	37.4	32.8	29.2	26.3	23.9
	FP2	2"	90.4	70.5	56.6	45.8	37.6	31.2	26.1	22.0	18.7
		2.5"	95.1	74.3	60.7	51.1	44.1	38.8	34.0	29.1	25.0
		3"	99.7	78.0	63.8	53.7	46.3	40.7	36.2	32.6	29.7
		4"	108.4	85.2	69.8	58.8	50.7	44.5	39.6	35.6	32.4
	FP3	2"	90.6	71.2	56.6	45.8	37.6	31.2	26.1	22.0	18.7
		2.5"	103.3	81.0	66.6	56.5	47.5	40.0	34.0	29.1	25.0
		3"	109.4	85.6	70.0	58.9	50.8	44.6	39.7	35.4	30.7
		4"	112.3	88.3	72.3	61.0	52.6	46.1	41.0	36.9	33.5

Notes:

1. The Load Span Table above is based on Allowable Stress Design (ASD). For loads calculated based on ASCE 7-10 (LRFD), please refer to section 2.4.1 of ASCE 7-10 for the applicable load combinations using Allowable Stress Design.
2. Based on CF-panel with 24 ga. Striated exterior and 26 ga. Striated interior face (min $F_y = 33$ ksi).
3. Fastener pattern FP1 is based on CF panel clips fastened to min. 14 ga. steel. Fastener options will be (2) ¼"-14 SDS Type 3, (2) ¼"-14 Self-Tapping, (2) ¼"-14 Type 5 SDS, (2) ¼"-20 Type 5 SDS, or (2) ¼"-28 Type 5 SDS. Fastener selection will be based on fastener pullout capacity from support steel members.
4. For CF-30, FP2 is based on FP1 along with (1) blind rivet at 10" o.c. from female panel sidelap. For CF-36, FP2 is based on FP1 along with (1) blind rivet at 12" o.c from female panel sidelap.
5. For CF-30, FP3 is based on FP1 along with (2) blind rivets at 10" o.c. from female panel sidelap. For CF-36, FP3 is based on FP1 along with (2) blind rivets at 12" o.c from female panel sidelap.
6. Allowable loads based on panel stress, connection strength and deflection design criteria are derived from ASTM E72 and E1592 structural testing.
7. The allowable inward or outward loads is the smallest load calculated with a factor of safety of 2.5 for bending stress, 3.0 for shear stresses, 2.0 for connection and deflection limitation of L/180.
8. The structural capacity of the supports are not considered and must be examined independently.


Metl-Span Striated Wall Panels⁷
24 Ga. Exterior / 26 ga. Interior Facings
Allowable Positive Load^{1,4,5,6} (psf)
Two or More Equal Spans

Panel Type ²	Design Criteria ³	Support Span							
		5 ft	6 ft	7 ft	8 ft	9 ft	10 ft	11 ft	12 ft
2" Thick	Bending & Shear	71.2	58.6	49.8	43.1	37.9	33.9	27.5	22.5
	Deflection (L/180)	71.8	56.6	45.8	37.6	31.2	26.1	22.0	18.7
2½" Thick	Bending & Shear	81.0	66.6	56.5	49.0	43.2	38.5	33.9	27.4
	Deflection (L/180)	87.5	69.6	56.9	47.5	40.0	34.0	29.1	25.0
3" Thick	Bending & Shear	90.1	73.9	62.6	54.3	47.9	42.9	38.6	32.5
	Deflection (L/180)	100.6	80.6	66.4	55.8	47.5	40.9	35.4	30.7
4" Thick	Bending & Shear	95.5	78.3	66.2	57.3	50.5	45.1	40.8	37.2
	Deflection (L/180)	118.5	96.0	79.8	67.7	58.3	50.8	44.6	39.6

Notes:

1. The Load Span Table above is based on Allowable Stress Design (ASD). For loads calculated based on ASCE 7-10 (LRFD), please refer to section 2.4.1 of ASCE 7-10 for the applicable load combinations using Allowable Stress Design.
2. Based on CF-panel with 24 ga. Striated-exterior and 26 ga. Light Mesa interior face (min $F_y = 33$ ksi).
3. Refer to the allowable connection load chart, for suction loads.
4. Allowable positive or suction load is the lowest value of panel bending strength, shear strength, deflection limit and connection strength for each fastener pattern.
5. Allowable loads based on panel stress and deflection design criteria are derived from ASTM E72 structural testing and calculated with factor of safety of 2.5 for bending stress, 3.0 for shear stresses and deflection limitation of L/180.
6. The structural capacity of the purlins are not considered and must be examined independently.
7. Consult Metl-Span for recommendations on panel profile and gage suitable for thermal stresses.

SUPPORT
(NOT BY METL-SPAN)

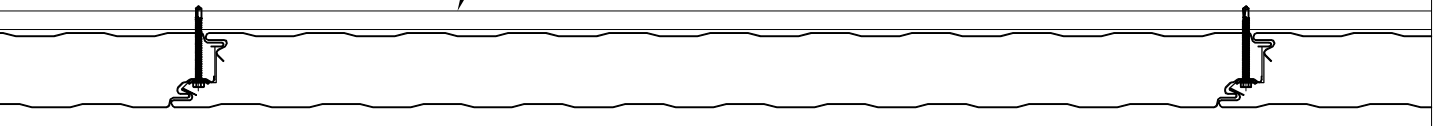


(FP1) SIDE JOINT CLIP ONLY

FROM FEMALE
EDGE (CRITICAL)

SUPPORT
(NOT BY METL-SPAN)

10.5"

10.5"

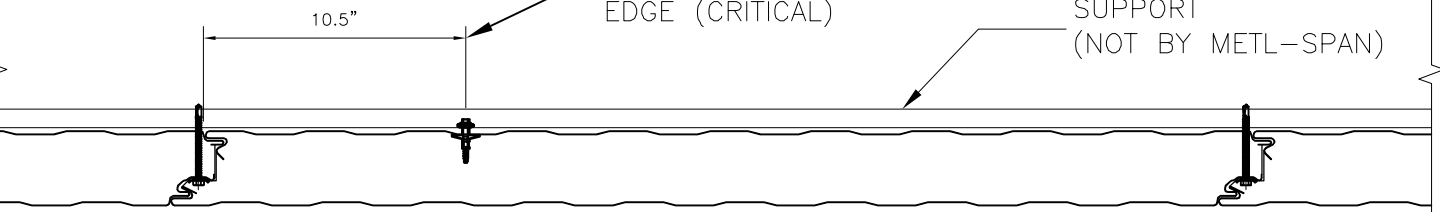


(FP2) SIDE JOINT AND (1) BLIND RIVET

SUPPORT
(NOT BY METL-SPAN)

10.5"

10.5"

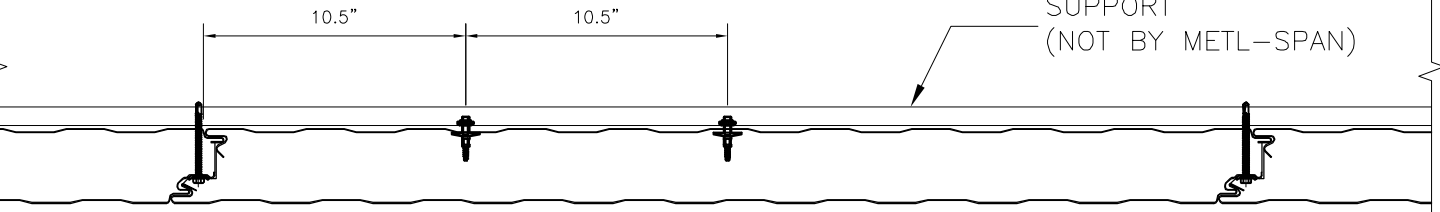


(FP3) SIDE JOINT AND (2) BLIND RIVETS

SUPPORT
(NOT BY METL-SPAN)

10.5"


10.5"

10.5"

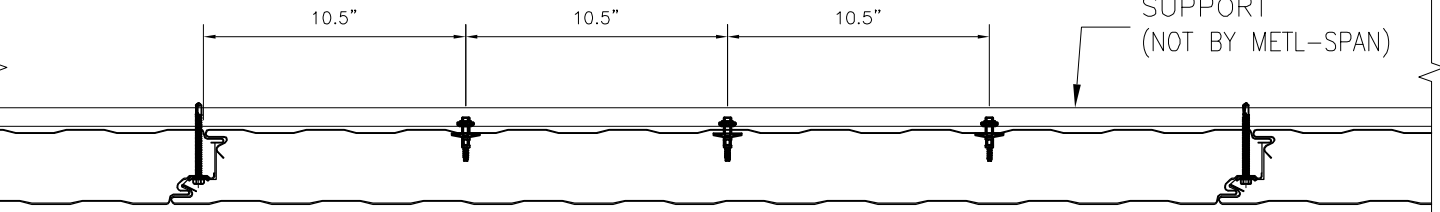


(FP4) SIDE JOINT AND (3) BLIND RIVETS

CF42 FASTENING PATTERNS

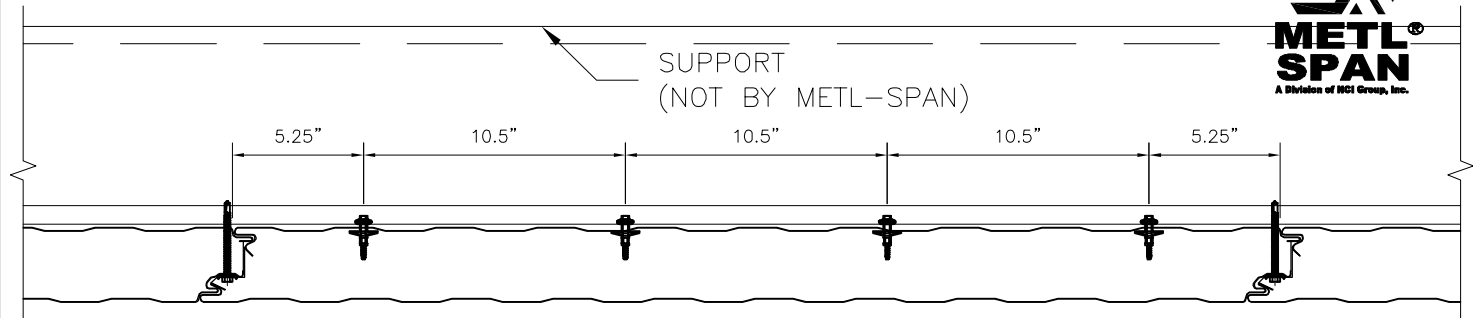


SUPPORT
(NOT BY METL-SPAN)

(FP5) SIDE JOINT AND (4) BLIND RIVETS

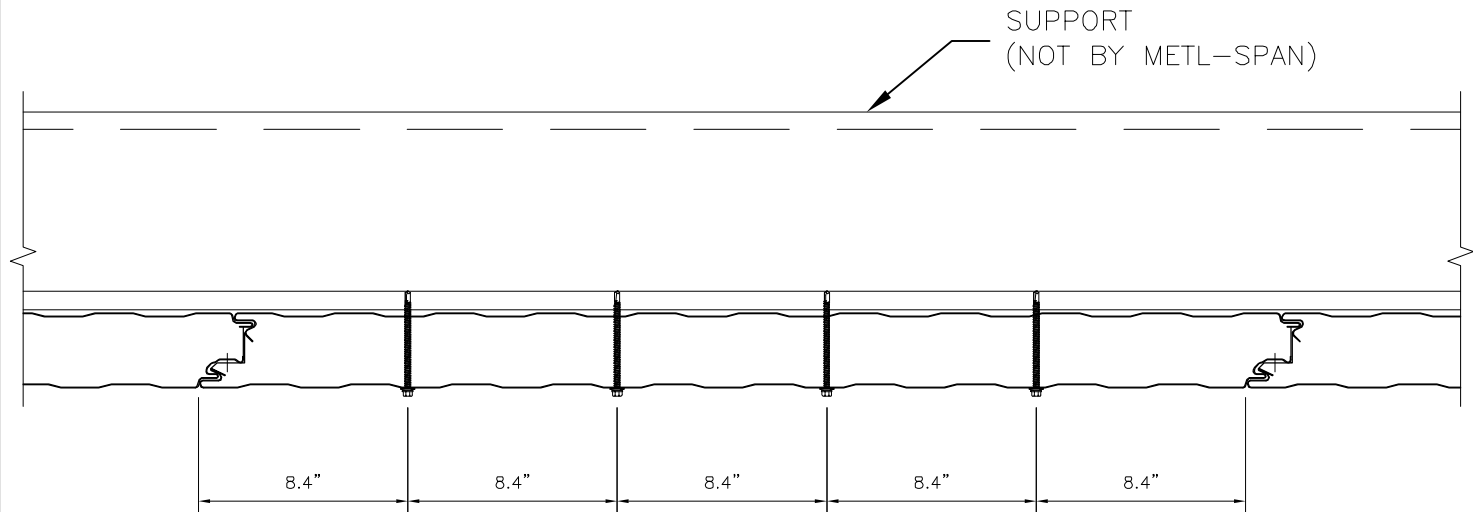

SUPPORT
(NOT BY METL-SPAN)


(FP9) (4) SELF-DRILLING OR SELF-TAPPING FASTENERS
W/ NEOPRENE BONDED WASHER

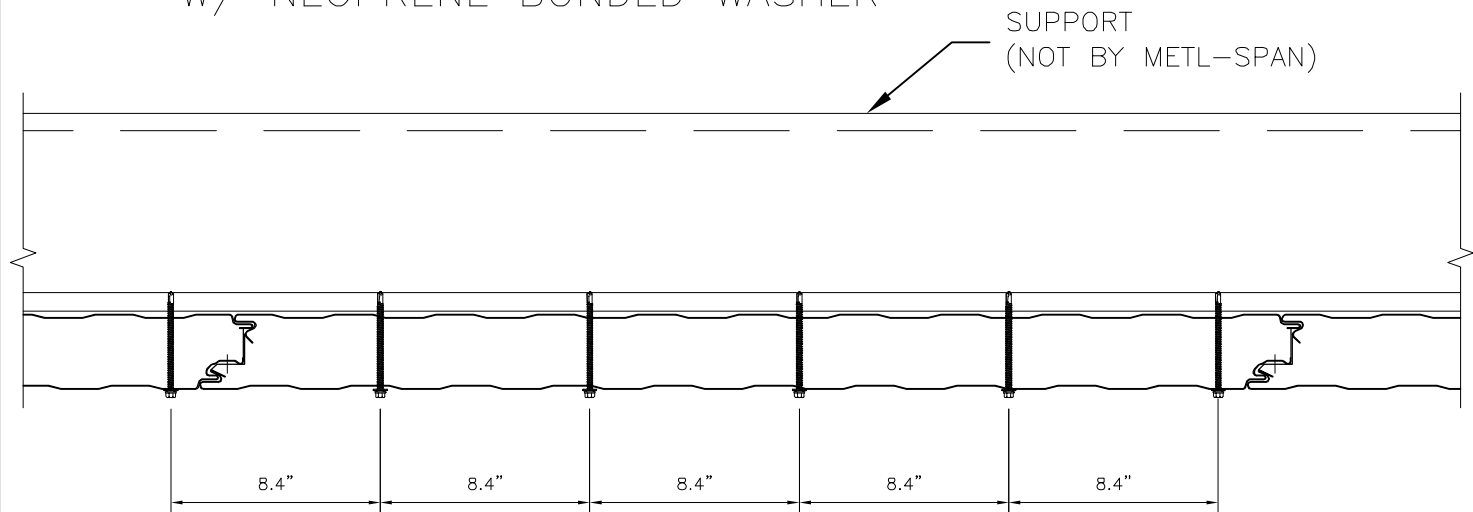


SUPPORT
(NOT BY METL-SPAN)

(FP10) (5) SELF-DRILLING OR SELF-TAPPING FASTENERS
W/ NEOPRENE BONDED WASHER


CF42 FASTENING PATTERNS

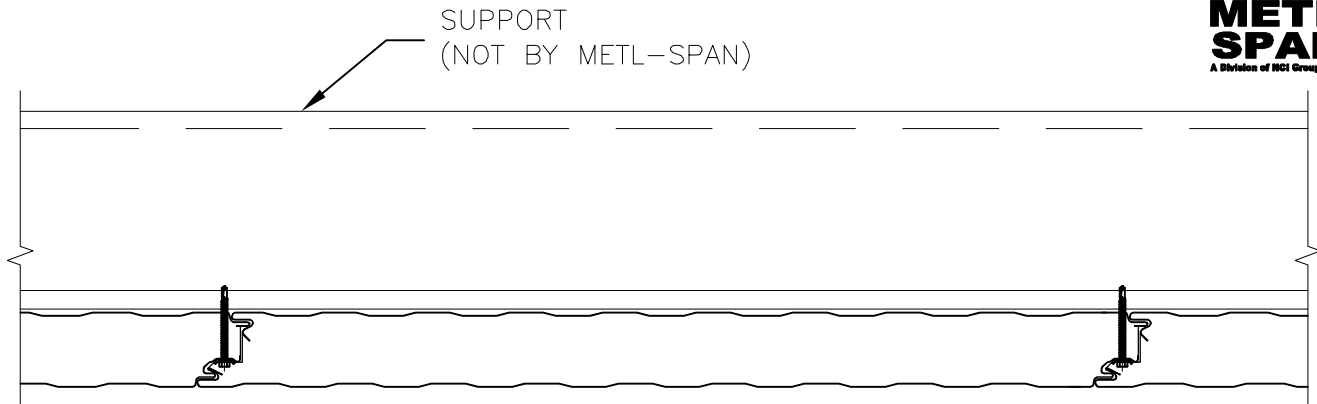

(FP1) SIDE JOINT CLIP ONLY

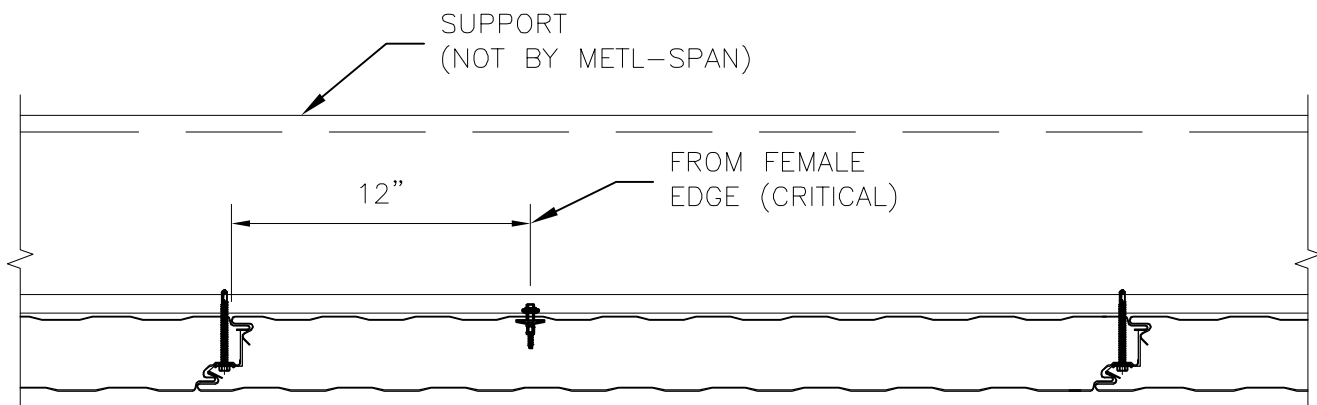


(FP2) SIDE JOINT AND (1) BLIND RIVET

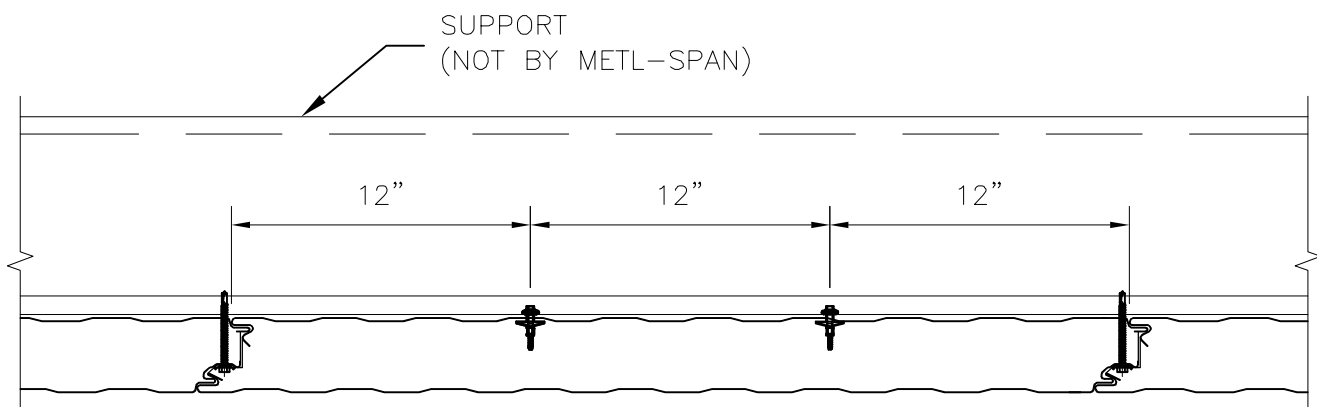


(FP3) SIDE JOINT AND (2) BLIND RIVETS


CF36 FASTENING PATTERNS

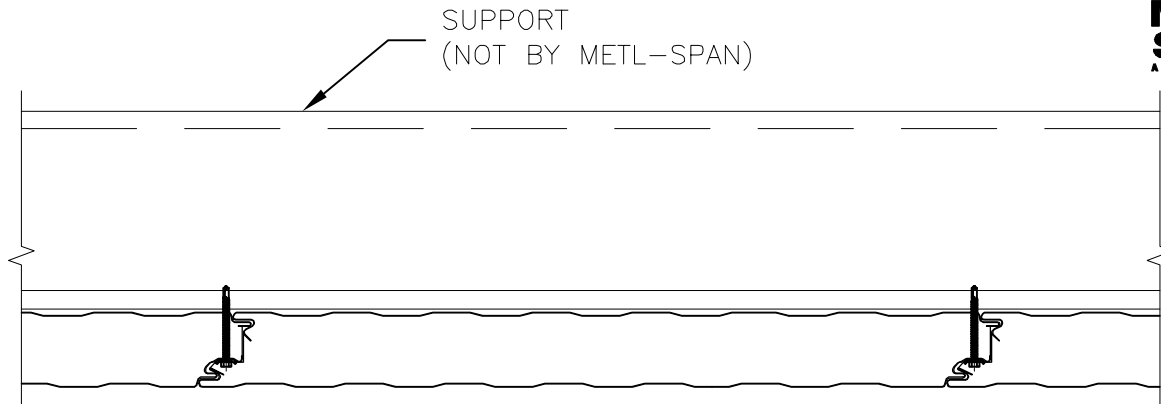

(FP1) SIDE JOINT CLIP ONLY

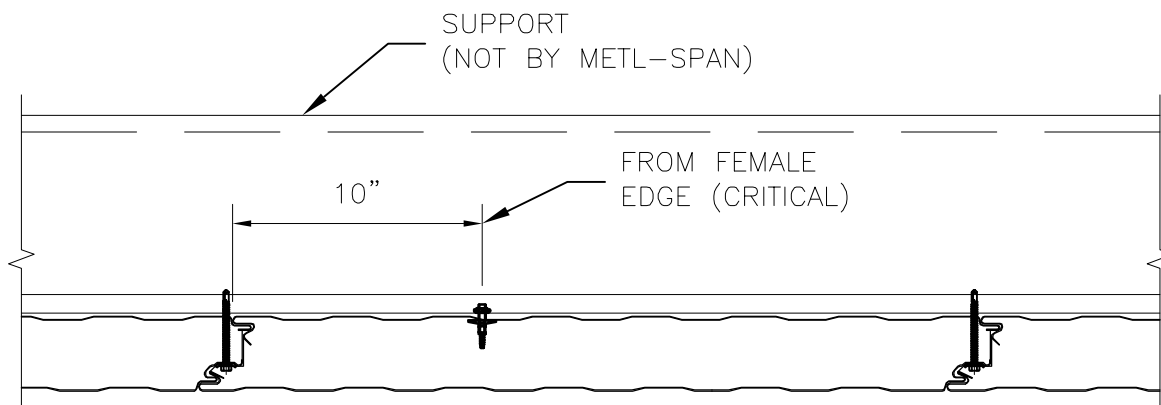

(FP2) SIDE JOINT AND (1) BLIND RIVET

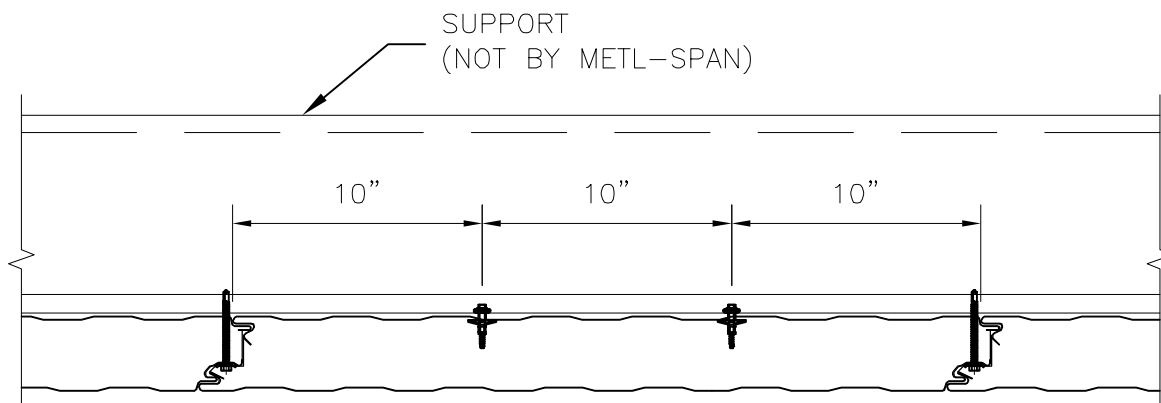

(FP3) SIDE JOINT AND (2) BLIND RIVETS

CF30 FASTENING PATTERNS